

TEST REPORT

No. : SHIN2512003219CM01_EN

Date : 2025-12-09

Page: 1 of 3

CUSTOMER NAME: SHANGHAI INTCO INDUSTRIES CO., LTD.

ADDRESS: NO.1299 HUBIN RD, FENGXIAN DISTRICT, SHANGHAI, CHINA

Sample Name : PS Wall Panel

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Date of Receipt : 2025-12-01

Testing Period : 2025-12-01 ~ 2025-12-09

Test result(s) : For further details, please refer to the following page(s)
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

Signed for
SGS-CSTC Standards Technical
Services (Shanghai) Co., Ltd..

Xander Yang
Authorized signatory

TEST REPORT

No. : SHIN2512003219CM01_EN

Date : 2025-12-09

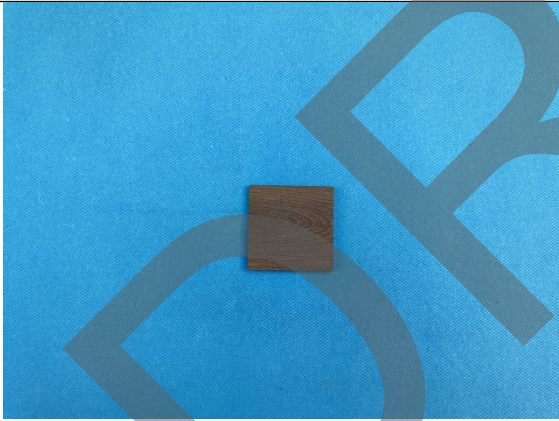
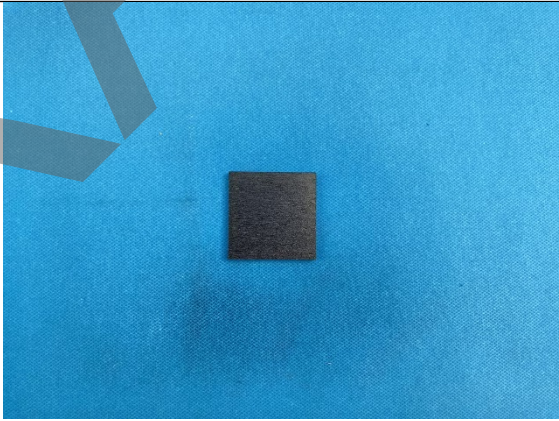
Page: 2 of 3

Summary of Results:

No.	Test Item	Test Method	Result	Conclusion
1	Swelling in Thickness after Immersion in Water	With Reference to EN 317:1993	0.1 %	N/A

Note: Pass : Meet the requirements;
 Fail : Does not meet the requirements;
 N/A : Not Apply to the judgment.

Original Sample Photo(s):

	
Front View	Back View

TEST REPORT

No. : SHIN2512003219CM01_EN

Date : 2025-12-09

Page: 3 of 3

Test Item: Swelling in Thickness after Immersion in Water

Test Method: With Reference to EN 317:1993

Test Condition:

Specimen: 50mm×50mm×5.5mm, 8pcs

Immersion conditions: pH=7, 20℃, 24h

Soaking method: Total immersion

Test Result:

Test Item	Test Result								
	Individual Value								Average Value
Swelling in Thickness after Immersion in Water (%)	0.0	0.0	0.0	0.6	0.0	0.0	0.0	0.0	0.1

The test report shall only be used for clients' scientific research, teaching, internal quality control, product research and development, etc... and just for internal reference.

*****End of report*****