

Test Report

Number: CZDG00568654

Applicant:



Date: Jan 09, 2018

Sample Description:


One (1) group of submitted sample said to be :

Item name : **WPC Cladding**

Manufacturer :

Country of Origin :

Date Sample Received : Dec 06, 2017

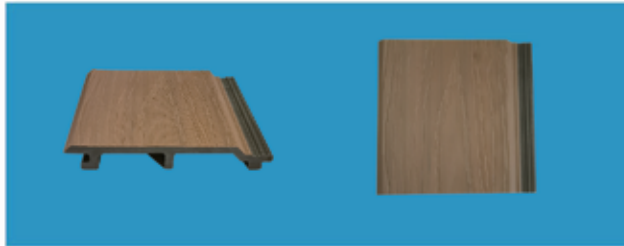

Tests conducted:

As requested by the applicant, refer to attached page(s) for details.

Conclusion:

Tested sample
Submitted sample


Test item
Fire Classification Test on WPC Cladding

Result
B_{fl}—s1

- As per EN 13501-1:2007+A1:2009

Authorized by:

For Intertek Testing Services Shenzhen Ltd.
Guangzhou Branch. Hardlines


Ben N.L. Lin
General Manager



Page 1 of 4

Intertek Testing Services Shenzhen Limited, Guangzhou Branch

深圳天祥质量技术服务有限公司广州分公司

#111 TCL Cultural Industry Park, Guangpu-west Road, Science City, High and New Technology Industrial Development Zone, Guangzhou. / E501, No.7-2, Caipin Road, Guangzhou Science City, GETDD Guangzhou.

广州高新技术产业开发区科学城光谱西路 69 号 TCL 文化产业园汇创空间 111/广州经济技术开发区科学城彩虹路 7 号之二 E501(510663)

Tel +8620 8213 9688
Fax +8620 3205 3537
intertek.com.cn
intertek.com



Test Report

Number: CZDG00568654

Tests Conducted

1 Fire Classification Test on WPC Cladding

As per the client's request, the tested samples were subjected to the following

tests. Sample description: WPC Cladding

Sample thickness: 25.0 mm

Initial inspection: No any damage was found

Executive summary:

No.	Test item			Test method	Standard's requirement		Test result	Conclusion
1	Critical heat flux			EN ISO 9239-1: 2010	B _{fl}	≥8.0 kW/m ²	8.5 kW/m ²	Pass
2	Flammability	Surface flame attack (Exposure = 15 s)	Flame spread within 20s	EN ISO 11925-2: 2010		≤150mm	123mm	Pass
3	Smoke production			EN ISO 9239-1:2010	s1	≤750%×min	695%×min	Class: s1
					s2	Not s1		
Conclusion	EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements — Part 1: Classification using data from reaction to fire tests: B _{fl} —s1							
Remark	The test results relate to the behavior of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.							



Test Report

Number: CZDG00568654

Tests Conducted

Annex A

Classes of reaction to fire performance for floorings:

Class	Test method(s)	Classification criteria	Additional classification
A1 _{fl}	EN ISO 1182 ^a and	$\Delta T \leq 30\text{ }^{\circ}\text{C}$; and $\Delta m \leq 50\%$; and $t_f = 0$ (i.e. no sustained flaming)	-
	EN ISO 1716	$PCS \leq 2,0\text{ MJ/kg}^a$ and $PCS \leq 2,0\text{ MJ/kg}^b$ and $PCS \leq 1,4\text{ MJ/m}^2^c$ and $PCS \leq 2,0\text{ MJ/kg}^d$	-
A2 _{fl}	EN ISO 1182 ^a or	$\Delta T \leq 50\text{ }^{\circ}\text{C}$ and $\Delta m \leq 50\%$ and $t_f \leq 20\text{ s}$	-
	EN ISO 1716 and	$PCS \leq 3,0\text{ MJ/kg}^a$ and $PCS \leq 4,0\text{ MJ/m}^2^b$ and $PCS \leq 4,0\text{ MJ/m}^2^c$ and $PCS \leq 3,0\text{ MJ/kg}^d$	-
	EN ISO 9239-1 ^e	Critical flux $f \geq 8,0\text{ kW/m}^2$	Smoke production ^g
B _{fl}	EN ISO 9239-1 ^e and	Critical flux $f \geq 8,0\text{ kW/m}^2$	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150\text{ mm}$ within 20 s	-
C _{fl}	EN ISO 9239-1 ^e and	Critical flux $f \geq 4,5\text{ kW/m}^2$	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150\text{ mm}$ within 20 s	-
D _{fl}	EN ISO 9239-1 ^e and	Critical flux $f \geq 3,0\text{ kW/m}^2$	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150\text{ mm}$ within 20 s	-
E _{fl}	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150\text{ mm}$ within 20 s	-
F _{fl}	No performance determined		



Test Report

Number: CZDG00568654

Tests Conducted

- ^a For homogeneous products and substantial components of non-homogeneous products.
^b For any external non-substantial component of non-homogeneous products.
^c For any internal non-substantial component of non-homogeneous products.
^d For the product as a whole.
^e Test duration = 30 min.
^f Critical flux is defined as the radiant flux at which the flame extinguishes or the radiant flux after a test period of 30 min, whichever is the lower (i.e. the flux corresponding with the furthest extent of spread of flame).
^g s1 = Smoke $\leq$ 750 % minutes;
s2 = not s1.
^h Under conditions of surface flame attack and, if appropriate to the end use application of the product, edge flame attack

End of report

This report is made solely on the basis of your instructions and/or information and materials supplied by you. It is not intended to be a recommendation for any particular course of action. Intertek does not accept a duty of care or any other responsibility to any person other than the Client in respect of this report and only accepts liability to the Client insofar as is expressly contained in the terms and conditions governing Intertek's provision of services to you. Intertek makes no warranties or representations either express or implied with respect to this report save as provided for in those terms and conditions. We have aimed to conduct the Review on a diligent and careful basis and we do not accept any liability to you for any loss arising out of or in connection with this report, in contract, tort, by statute or otherwise, except in the event of our gross negligence or wilful misconduct. This report shall not be reproduced unless with prior written approval from Intertek Testing Services Shenzhen Limited, Guangzhou Branch.



Page 4 of 4

Intertek Testing Services Shenzhen Limited, Guangzhou Branch

深圳天祥质量技术服务有限公司广州分公司

#111 TCL Cultural Industry Park, Guangpu-west Road, Science City, High and New Technology Industrial Development Zone, Guangzhou. / E501, No.7-2, Caipin Road, Guangzhou Science City, GETDD Guangzhou.

广州高新技术产业开发区科学城光复西路 69 号 TCL 文化产业园汇创空间 111/广州经济技术开发区科学城彩频路 7 号之二 E501(510663)

Tel +8620 8213 9688
Fax +8620 3205 3537
intertek.com.cn
intertek.com

